

Thermostat with off cycle defrost XR20C - XR20D

CONTENTS

1. GENERAL WARNING	1
2. GENERAL DESCRIPTION	1
3. CONTROLLING LOADS	1
4. FRONT PANEL COMMANDS	1
5. LIST OF PARAMETERS	2
6. INSTALLATION AND MOUNTING	2
7. ELECTRICAL CONNECTIONS	2
8. ALARM SIGNALS	2
9. TECHNICAL DATA	2
10. CONNECTIONS	2
11. DEFAULT SETTING VALUES	3

1. GENERAL WARNING

1.1 PLEASE READ BEFORE USING THIS MANUAL

- This manual is part of the product and should be kept near the instrument for easy and quick reference.
- The instrument shall not be used for purposes different from those described hereunder. It cannot be used as a safety device.

1.2 SAFETY PRECAUTIONS


- Check the supply voltage is correct before connecting the instrument.
- Do not expose to water or moisture: use the controller only within the operating limits avoiding sudden temperature changes with high atmospheric humidity to prevent formation of condensation
- Warning: disconnect all electrical connections before any kind of maintenance.
- The instrument must not be opened.
- Fit the probe where it is not accessible by the end user.
- In case of failure or faulty operation send the instrument back to the distributor or to "Dixell s.r.l." (see address) with a detailed description of the fault.
- Consider the maximum current which can be applied to each relay (see Technical Data).
- Ensure that the wires for probes, loads and the power supply are separated and far enough from each other, without crossing or intertwining.
- In case of applications in industrial environments, the use of mains filters (our mod. FT1) in parallel with inductive loads could be useful.

2. GENERAL DESCRIPTION

Models XR20C, format 32 x 74 mm, and XR20D, DIN rail format, are thermostats with off cycle defrost designed for refrigeration applications at normal temperature. They provides a relay output to drive the compressor and a PTC or NTC probe input. A internal timer manages the off cycle defrost. The instruments are fully configurable through special parameters that can be easily programmed through the keyboard.

3. CONTROLLING LOADS

3.1 THE COMPRESSOR

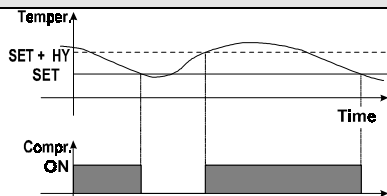



The regulation is performed according to the temperature measured by the thermostat probe with a positive differential from the set point: if the temperature increases and reaches set point plus differential the compressor is started and then turned off when the temperature reaches the set point value again.

In case of fault in the thermostat probe the start and stop of the compressor are timed through parameters "COn" and "COF".

3.2 DEFROST

Defrost is performed through a simple stop of the compressor. Parameter "IdF" controls the interval between defrost cycles, while its length is controlled by parameter "MdF".

4. FRONT PANEL COMMANDS



SET: To display target set point; in programming mode it selects a parameter or confirm an operation.

DEF (DEF) To start a manual defrost

▲ (UP): To see the max. stored temperature; in programming mode it browses the parameter codes or increases the displayed value.

▼ (DOWN) To see the min stored temperature; in programming mode it browses the parameter codes or decreases the displayed value.

KEY COMBINATIONS:

▲ + ▼ To lock & unlock the keyboard.

SET + ▼ To enter the programming mode.

SET + ▲ To return to the room temperature display.

4.1 MEANING OF LEDS

Each LED function is described in the following table.

LED	MODE	FUNCTION
	ON	Compressor enabled
	Flashing	-Programming Phase (flashing with) - Anti-short cycle delay enabled
	ON	Defrost enabled
	Flashing	- Programming Phase (flashing with) - Drip time in progress

4.2 HOW TO SEE THE MIN TEMPERATURE

- Press and release the ▼ key.
- The "Lo" message will be displayed followed by the minimum temperature recorded.
- By pressing the ▼ key again or by waiting 5s the normal display will be restored.

4.3 HOW TO SEE THE MAX TEMPERATURE

- Press and release the ▲ key.
- The "Hi" message will be displayed followed by the maximum temperature recorded.
- By pressing the ▲ key again or by waiting 5s the normal display will be restored.

4.4 HOW TO RESET THE MAX AND MIN TEMPERATURE RECORDED

- Hold press the SET key for more than 3s, while the max. or min temperature is displayed. (rSt message will be displayed)
- To confirm the operation the "rSt" message starts blinking and the normal temperature will be displayed.

Note: at the first installation reset the max&min recorded temperatures.

4.5 HOW TO SEE THE SETPOINT

- Push and immediately release the SET key: the display will show the Set point value;

- Push and immediately release the SET key or wait for 5 seconds to display the probe value again.

4.6 HOW TO CHANGE THE SETPOINT

- Push the SET key for more than 2 seconds to change the Set point value;
- The value of the set point will be displayed and the LED starts blinking;
- To change the Set value push the ▲ or ▼ arrows.
- To memorise the new set point value push the SET key again or wait 15s.

4.7 HOW TO START A MANUAL DEFROST

- Push the DEF key for more than 2 seconds and a manual defrost will start.

4.8 HOW TO CHANGE A PARAMETER VALUE

- To change the parameter's value operate as follows:
 - Enter the Programming mode by pressing the Set and ▼ key for 3s (and start blinking).
 - Select the required parameter.

- Press the "SET" key to display its value. (Now only the LED is blinking).

- Use ▲ or ▼ to change its value.

- Press "SET" to store the new value and move to the following parameter.

To exit: Press SET + UP or wait 15s without pressing a key.

NOTE: the set value is stored even when the procedure is exited by waiting the time-out to expire.

4.9 THE HIDDEN MENU

The hidden menu includes all the parameters of the instrument.

4.9.1 HOW TO ENTER THE HIDDEN MENU

- Enter the Programming mode by pressing the Set + ▼ key for 3s (and start blinking).

- When a parameter is displayed keep pressed the Set+▼ for more than 7s. The Pr2 label will be displayed immediately followed from the HY parameter. **NOW YOU ARE IN THE HIDDEN MENU.**

- Select the required parameter.

- Press the "SET" key to display its value (Now only the LED is blinking).

- Use ▲ or ▼ to change its value.

- Press "SET" to store the new value and move to the following parameter.

To exit: Press SET + ▲ or wait 15s without pressing a key.

NOTE: the set value is stored even when the procedure is exited by waiting the time-out to expire.

4.9.2 HOW TO MOVE A PARAMETER FROM THE HIDDEN MENU TO THE FIRST LEVEL AND VICEVERSA.

Each parameter present in the HIDDEN MENU can be removed or put into "THE FIRST LEVEL" (user level) by pressing "SET + ▼".

In the HIDDEN MENU when a parameter is present in First Level the decimal point is on.

4.10 HOW TO LOCK THE KEYBOARD



- Keep pressed for more than 3 s the ▲ and ▼ keys.
- The "POF" message will be displayed and the keyboard will be locked. At this point it will be possible only to see the set point or the MAX o Min temperature stored
- If a key is pressed more than 3s the "POF" message will be displayed.

4.11 TO UNLOCK THE KEYBOARD

Keep pressed together for more than 3s the ▲ and ▼ keys till the Pon message will be displayed.

4.12 THE CONTINUOUS CYCLE



When defrost is not in progress, it can be activated by holding the "▲" key pressed for about 3 seconds. The compressor operates in continuous mode for the time set through the "CCt" parameter. The cycle can be terminated before the end of the set time using the same activation key "▲" for 3 seconds.

5. LIST OF PARAMETERS

NOTE: the parameters preceded by dots are only in the Hidden Menu.

REGULATION

Hy Differential: $(0.1 \div 25.5^{\circ}\text{C} / 1 \div 255^{\circ}\text{F})$ Intervention differential for set point. Compressor Cut IN is Set Point Plus Differential (Hy). Compressor Cut OUT is when the temperature reaches the set point.

• **LS Minimum set point:** $(-50^{\circ}\text{C} + \text{SET} / -58^{\circ}\text{F} + \text{SET})$: Sets the minimum acceptable value for the set point.

• **US Maximum set point:** $(\text{SET} + 150^{\circ}\text{C} / \text{SET} + 302^{\circ}\text{F})$. Set the maximum acceptable value for set point.

Ot Thermostat probe calibration: $(-12.0 \div 12.0^{\circ}\text{C}; -120 \div 120^{\circ}\text{F})$ allows the adjustment of possible offset of the thermostat probe.

• **OdS Outputs activation delay at start up:** $(0 \div 255 \text{ min})$ This function is enabled at the initial start up of the instrument and inhibits any output activation for the period of time set in the parameter.

AC Anti-short cycle delay: $(0 \div 50 \text{ min})$ minimum interval between the compressor stop and the following restart.

• **CCt Compressor ON time during continuous cycle:** $(0.0 \div 24.0 \text{ h}; \text{res. } 10 \text{ min})$ Allows to set the length of the continuous cycle: compressor stays on without interruption for the CCt time. Can be used, for instance, when the room is filled with new products.

• **COOn Compressor ON time with faulty probe:** $(0 \div 255 \text{ min})$ time during which the compressor is active in case of faulty thermostat probe. With COOn=0 compressor is always OFF.

• **COF Compressor OFF time with faulty probe:** $(0 \div 255 \text{ min})$ time during which the compressor is OFF in case of faulty thermostat probe. With COF=0 compressor is always active.

CH Type of action: CL = cooling; Ht = heating.

DISPLAY

• **CF Temperature measurement unit:** $^{\circ}\text{C} = \text{Celsius}; ^{\circ}\text{F} = \text{Fahrenheit}$ **WARNING:** When the measurement unit is changed the SET point and the values of the parameters Hy, LS, US, Ot, ALU and ALL have to be checked and modified if necessary.

rES Resolution (for $^{\circ}\text{C}$): $(\text{in } 1^{\circ}\text{C}; \text{dE } 0.1^{\circ}\text{C})$ allows the decimal point displaying.

DEFROST

IdF Interval between defrost cycles: $(1 \div 120 \text{ h})$ Determines the time interval between the beginning of two defrost cycles.

MdF Length for defrost: $(0 \div 255 \text{ min})$ It sets the defrost duration.

• **dFd Temperature displayed during defrost:** $(\text{rt} = \text{real temperature}; \text{it} = \text{temperature at defrost start}; \text{SEt} = \text{set point}; \text{dEF} = \text{"dEF" label})$

• **dAd MAX display delay after defrost:** $(0 \div 255 \text{ min})$. Sets the maximum time between the end of defrost and the restarting of the real room temperature display.

ALARMS

• **ALC Temperature alarms configuration:** $(\text{Ab}; \text{rE})$
Ab= absolute temperature: alarm temperature is given by the ALL or ALU values. rE = temperature alarms are referred to the set point. Temperature alarm is enabled when the temperature exceeds the "SET+ALU" or "SET-ALL" values.

ALU MAXIMUM temperature alarm: $(\text{With } \text{ALC}=\text{Ab}; \text{ALL} \div 150^{\circ}\text{C}; \text{ALL} \div 302^{\circ}\text{F}; \text{with } \text{ALC}=\text{rE } 0 \div 50^{\circ}\text{C}; 0 \div 90^{\circ}\text{F})$ when this temperature is reached the alarm is enabled, after the "ALd" delay time.

ALL Minimum temperature alarm: $(\text{With } \text{ALC}=\text{Ab } -50.0^{\circ}\text{C} + \text{ALU}; -58^{\circ}\text{F} + \text{ALU}; \text{with } \text{ALC}=\text{rE } 0 \div 50^{\circ}\text{C}; 0 \div 90^{\circ}\text{F})$ when this temperature is reached the alarm is enabled, after the "ALd" delay time.

• **ALd Temperature alarm delay:** $(0 \div 255 \text{ min})$ time interval between the detection of an alarm condition and alarm signalling.

• **dAO Exclusion of temperature alarm at startup:** $(\text{from } 0.0 \text{ min to } 23.5 \text{ h})$ time interval between the detection of the temperature alarm condition after instrument power on and alarm signalling.

DIGITAL INPUT - Only for models with digital input

i1P Digital input polarity: oP: the digital input is activated by opening the contact. CL: the digital input is activated by closing the contact.

i1F Digital input configuration:

EAL = external alarm: "EA" message is displayed; bAL = serious alarm: "CA" message is displayed and the output is turned off; dEF = activation of a defrost cycle; AUS = do not select.

did Digital input alarm delay: $(0 \div 255 \text{ min})$ delay between the detection of the external alarm condition (i1F= EAL or i1F= bAL) and its signalling.

OTHER


PbC Probe selection: $(\text{Ptc}=\text{PTC probe}; \text{ntc}=\text{NTC probe})$. It allows the selection of the type of probe.

Ptb Parameter table in dex: readable only. For internal use.


rEL Software release for internal use.

6. INSTALLATION AND MOUNTING

Instrument XR20C shall be mounted on panel, in a $29 \times 71 \text{ mm}$ hole, and fixed using the special brackets supplied.



To obtain an IP65 protection grade use the front panel rubber gasket (mod. RG-C) as shown in figure.

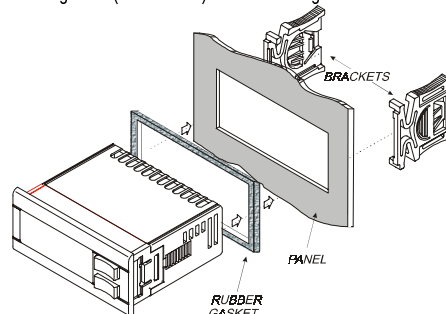

Instrument XR20D shall be mounted on an omega DIN rail. The temperature range allowed for correct operation is $0 \div 60^{\circ}\text{C}$. Avoid places subject to strong vibrations, corrosive gases, excessive dirt or humidity. The same recommendations apply to probes. Let air circulate by the cooling holes.

7. ELECTRICAL CONNECTIONS

The instruments are provided with screw terminal block to connect cables with a cross section up to 2.5 mm^2 . Heat-resistant cables have to be used. Before connecting cables make sure the power supply complies with the instrument's requirements. Separate the probe cables from the power supply cables, from the outputs and the power connections. Do not exceed the maximum current allowed on each relay, in case of heavier loads use a suitable external relay.

7.1 PROBE CONNECTION

The probes shall be mounted with the bulb upwards to prevent damages due to casual liquid infiltration. It is recommended to place the probe away from air streams to correctly measure the average room temperature.

8. ALARM SIGNALS

Message	Cause	Output
"EE"	Data or memory failure	
"P1"	Room probe failure	Output according to par. "Con" and "COF"
"HA"	Maximum temp. alarm	Output unchanged.
"LA"	Minimum temp. alarm	Output unchanged.
"EA"	External alarm	Output unchanged.
"CA"	Serious external alarm	Output OFF.

*Only for instruments with digital input

8.1 ALARM "EE"

The instrument is provided with an internal check verifying memory integrity. Alarm "EE" flashes when a failure in the internal memory is detected. In such case call the service.

8.2 ALARM RECOVERY

Probe alarm "P1" start some seconds after the fault in the related probe; it automatically stops some seconds after the probe restarts normal operation. Check connections before replacing the probe.

Temperature alarms "HA" and "LA" automatically stop as soon as the thermostat temperature returns to normal values and when defrost starts.

Alarms "CA" and "EA" recover as soon as the digital input is disabled.

9. TECHNICAL DATA

Housing: self extinguishing ABS.

Case: XR20C frontal $32 \times 74 \text{ mm}$; depth 60 mm ;

XR20D 4 DIN modules $70 \times 85 \text{ mm}$; depth 61 mm

Mounting

XR20C panel mounting in a $71 \times 29 \text{ mm}$ panel cut-out

XR20D DIN RAIL mounted in a omega (3) din rail

Protection: IP20.

Frontal protection:

XR20C IP65 with frontal gasket RG-C (optional).

Connections: Screw terminal block $\leq 2.5 \text{ mm}^2$ heat-resistant wiring.

Power supply: according to the model: 12 Vac/dc , $\pm 10\%$; 24 Vac/dc , $\pm 10\%$; 230 Vac $\pm 10\%$, $50/60 \text{ Hz}$, 110 Vac $\pm 10\%$, $50/60 \text{ Hz}$

Power absorption: 3 VA max

Display: 3 digits, red LED, 14.2 mm high.

Inputs: 1 PTC or NTC probe.

Relay outputs

compressor

SPDT relay 8(3) A, 250 Vac or

SPST relay 20(8) A, 250 Vac

Data storing: on the non-volatile memory (EEPROM).

Kind of action: 1B.

Pollution grade: normal

Software class: A.

Operating temperature: $0 \div 60^{\circ}\text{C}$.

Storage temperature: $-25 \div 60^{\circ}\text{C}$.

Relative humidity: $20 \div 85\%$ (no condensing)

Measuring and regulation range:

PTC probe: $-50 \div 150^{\circ}\text{C}$ $(-58 \div 302^{\circ}\text{F})$


NTC probe: $-40 \div 110^{\circ}\text{C}$ $(-58 \div 230^{\circ}\text{F})$

Resolution: 0.1°C or 1°C or 1°F (selectable).

Accuracy (ambient temp. 25°C): $\pm 0.7^{\circ}\text{C} \pm 1 \text{ digit}$

10. CONNECTIONS

10.1.1 XR20C: COMPRESSOR 8A

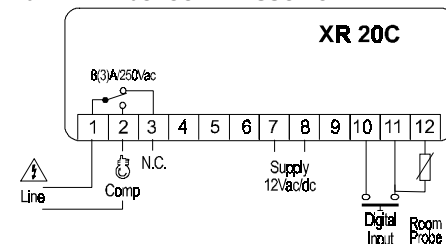


NOTE: digital input is an option

24 Vac/dc : supply the instrument to the terminals 7 - 8.

120 Vac : supply the instrument to the terminals 7 - 8.

230 Vac : supply the instrument to the terminals 7 - 8.

10.1.2 XR20C: COMPRESSOR 20A

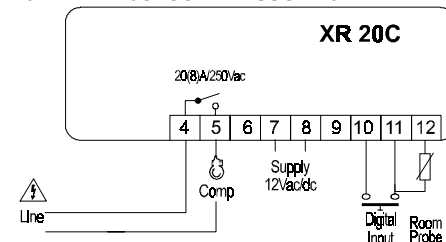


NOTE: digital input is an option

24 Vac/dc : supply the instrument to the terminals 7 - 8.

120 Vac : supply the instrument to the terminals 7 - 8.

230 Vac : supply the instrument to the terminals 7 - 8.


10.1.3 XR20D: COMPRESSOR 8A

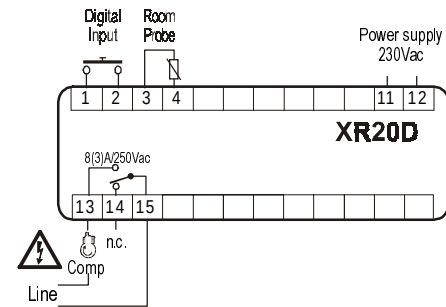

24Vac: supply the instrument to the terminals 11 - 12.

120Vac: supply the instrument to the terminals 11 - 12.

10.1.4 XR20D: COMPRESSOR 20A

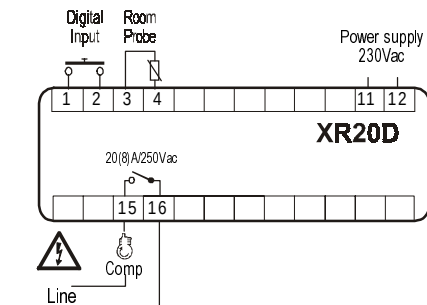

24Vac: supply the instrument to the terminals 11 - 12.

120Vac: supply the instrument to the terminals 11 - 12.

11. DEFAULT SETTING VALUES

Label	Name	Range	°C/°F
Set	Set point	LS+US	3/37
Hy	Differential	0,1+25,5°C/ 1+ 255°F	2/4
LS	Minimum set point	-50°C+SET/ -58°F+SET	-50/-58
US	Maximum set point	SET+150°C/ SET + 302°F	150/302
Ot	Thermostat probe calibration	-12+ 12°C / -120 + 120°F	0
OdS	Outputs delay at start up	0+255 min	0
AC	Anti-short cycle delay	0 + 50 min	1
CCt	Continuous cycle duration	0.0+24.0h	0.0
COu	Compressor ON time with faulty probe	0 + 255 min	15
COF	Compressor OFF time with faulty probe	0 + 255 min	30
CH	Type of action (cooling, heating)	CL, Ht	CL
CF	Temperature measurement unit	°C + °F	°C/°F
rES	Resolution	in + dE	dE/-
IdF	Interval between defrost cycles	1 + 120 hour	8
MdF	(Maximum) length for defrost	0 + 255 min	20
dFd	Displaying during defrost	rt, it, SET, DEF	it
dAd	MAX display delay after defrost	0 + 255 min	30
ALc	Temperat. alarms configuration	rE; Ab	Ab
ALU	MAXIMUM temperature alarm	ALL+150.0°C ALL +302°F	150/302
ALL	Minimum temperature alarm	-50.0°C+ALU/ -58°F + ALU	-50/-58
ALd	Temperature alarm delay	0 + 255 min	15
dAo	Delay of temperature alarm at start up	0 + 23h e 50'	1.3
iP*	Digital input polarity	oP; CL	CL
iF*	Digital input configuration	EAL; bAL; dEF; AUS	EAL
did*	Digital input alarm delay	0+255min	5
PbC	Probe selection	Ptc + ntc	Ptc/ntc
rEL	Software release	--	-
Ptb	Map code	--	-

*only on models with digital input.

Hidden parameters

